


NOTES:

CONSTRUCT STANDARD SIDEWALK 5' WIDE AND
4" THICK UNLESS OTHERWISE DENOTED ON PLANS.


PLACE A GROOVE JOINT 1" DEEP WITH 1/8" RADII
IN THE CONCRETE SIDEWALK AT 5' INTERVALS.
ONE 1/2" EXPANSION JOINT WILL BE REQUIRED AT 50'
INTERVALS. A 1/2" EXPANSION JOINT WILL BE REQUIRED
WHERE THE SIDEWALK JOINS ANY RIGID STRUCTURE.

SEE STD. DWG. 848.05 FOR WHEELCHAIR RAMP LOCATION
REQUIREMENTS AND CONSTRUCTION GUIDELINES.

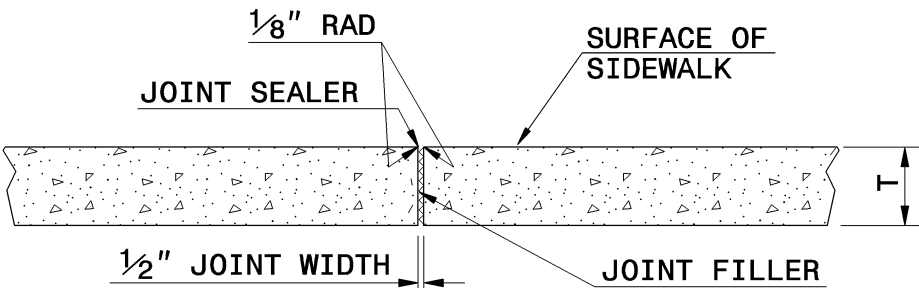


T = SIDEWALK THICKNESS

TRANSVERSE EXPANSION JOINT IN SIDEWALK

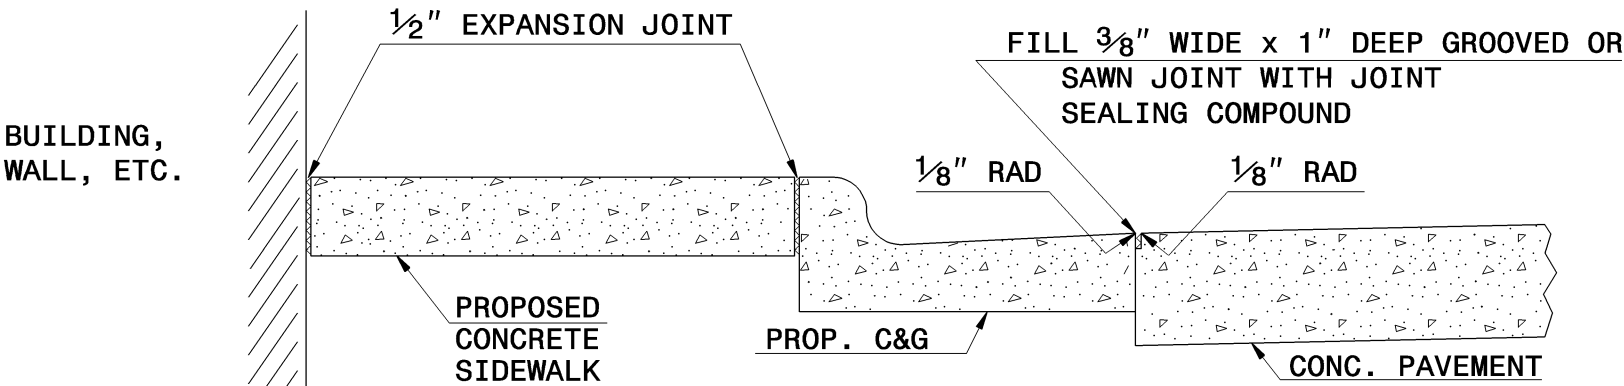

DETAILS SHOWING JOINTS IN CONCRETE SIDEWALK

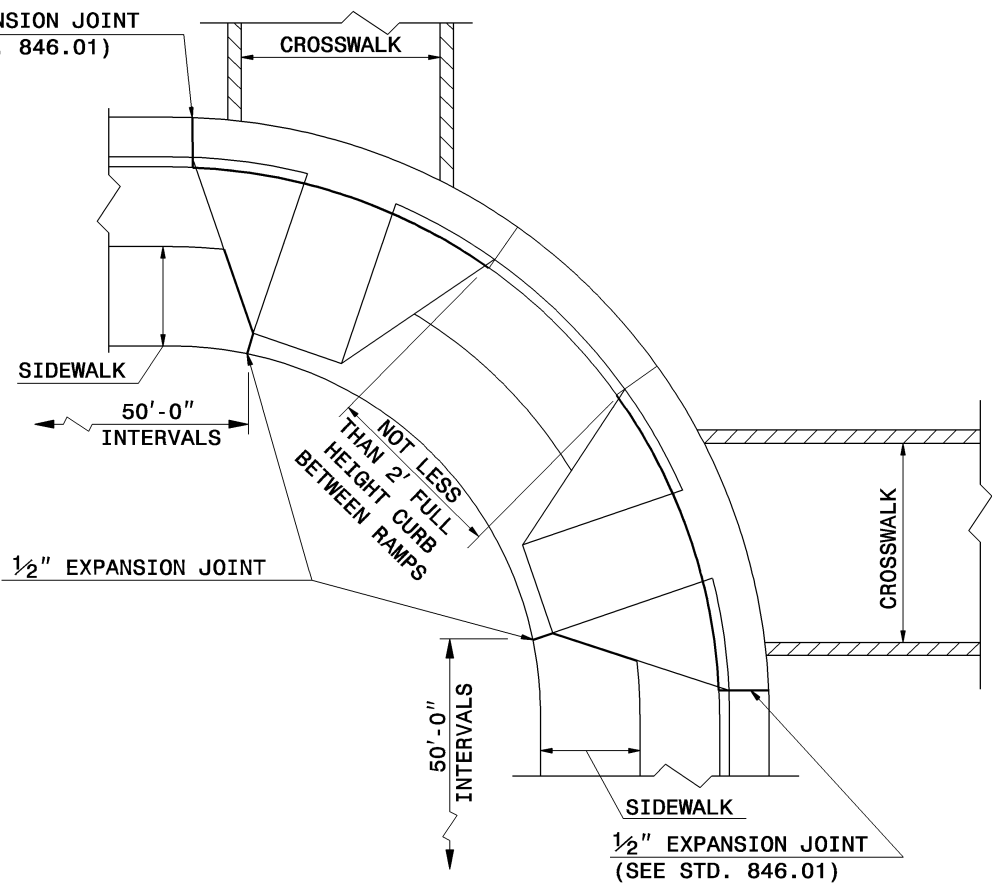

PLAN VIEW